

## ADDENDUM | No. 2

<b>PROJECT</b>	Harrison St and Mork St Extension		
<b>BID DATE</b>	2:00 PM	Local time	March 15, 2022
<b>BID LOCATION</b>	Office of the City Administrator/Clerk, City of Lake Benton 106 S. Center Street Lake Benton, MN 56149		
<b>ISSUE DATE</b>	March 11, 2022		
<b>NOTICE</b>	Failure to acknowledge all addenda in the BID may cause rejection of the BID. See Instructions to Bidders.		

### SCOPE OF THIS ADDENDUM

The following becomes a part of the original project manual and drawings, taking precedence over the items that may conflict. The bidder shall note receipt and make acknowledgment of the Addendum on his/her bid form, incorporating its provision in his/her bid.

### PROJECT MANUAL

The following additions, changes and clarifications have been made to the Project Manual.

#### C-410 Bid Form

*Delete bid form in its entirety. (from Addendum No 1)*

*Add revised bid form.*

### DRAWINGS

The following additions, changes and clarifications have been made to the Drawings.

#### Drawing Sheet B-1. Estimate of Quantities

*Remove: Remove Sheet B-1*

*Add: New Drawing Sheet*

#### Drawing Sheet N-3. Watermain Details

*Remove: Remove Sheet N-3*

*Add: New Drawing Sheet*



**NOTE**

The Plan Holders List and Addendums are available on our website at <http://www.bannerassociates.com> by clicking on **View Bid Information / Project Name / Project Information** link.

Project Manual and Drawing inquiries regarding the work should be directed to:

**CONTACT PERSON(S)**


Banner Associates, Inc.	Tel 1-605-692-6342   Toll Free 1-855-323-6342   Fax 1-605-692-5714
Scot Leddy	Project Manager <span style="float: right;">scotl@bannerassociates.com</span>

**ATTACHMENTS:**

- 1. C-410 Bid Form
- 2. Revised Drawing Sheets: B-1 and N-3.

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Print Name: Scot D. Leddy, PE



Signature

Date: 3/11/2022

License # 26814

## BID FORM FOR CONSTRUCTION CONTRACT

The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

### ARTICLE 1—OWNER AND BIDDER

1.01 This Bid is submitted to:

**City of Lake Benton  
106 S. Center Street, PO Box 206  
Lake Benton, MN 56149**

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

### ARTICLE 2—ATTACHMENTS TO THIS BID

2.01 The following documents are submitted with and made a condition of this Bid:

- A. Required Bid security;
- B. Evidence of authority to do business in the state of the Project; or a written covenant to obtain such authority within the time for acceptance of Bids;
- C. Contractor's license number as evidence of Bidder's State Contractor's License or a covenant by Bidder to obtain said license within the time for acceptance of Bids;

### ARTICLE 3—BASIS OF BID—UNIT PRICES

3.01 *Unit Price Bids*

- A. Bidder will perform the following Work at the indicated unit prices:

HARRISON ST AND MORK ST EXTENSION  
LAKE BENTON, MINNESOTA

-----

Item No.	SPEC SECTION	Description	Unit	Estimated Quantity	Bid Unit Price	Bid Amount
1	01 0000-5.4	Traffic Control	Lump Sum	1	\$	\$
2	01 7113-2.1	Mobilization	Lump Sum	1	\$	\$
3	31 2300-4.2	Granular Embedment	Ton	500	\$	\$
4	31 2300-4.3	Pipe Foundation Material	Ton	30	\$	\$
5	31 2400-4.2	Remove Bituminous Surfacing	SY	110	\$	\$
6	31 2400-4.2	Remove Concrete Surfacing	SF	570	\$	\$
7	31 2400-4.2	Remove Curb and Gutter	LF	4	\$	\$
8	31 2400-4.3	Compaction - Moisture / Density Tests	Each	15	\$	\$
9	31 2400-4.4	Strip and Stockpile Topsoil	CY	2,550	\$	\$
10	31 2400-4.5	Stockpile Excess Material	CY	930	\$	\$
11	31 2400-4.6	Install Stockpiled Topsoil	CY	625	\$	\$
12	31 2500-4.1	Storm Sewer Inlet Protection Device	Each	3	\$	\$
13	31 2500-4.2	Temporary Vehicle Construction Entrance	Each	2	\$	\$
14	31 2500-4.3	Concrete Washout Area	Each	1	\$	\$
15	31 2500-4.4	Erosion Control Blanket	SY	460	\$	\$
16	31 2500-4.5	Silt Fence	LF	130	\$	\$
17	31 2500-4.6	Erosion Control Wattle	LF	20	\$	\$
18	32 1132-4.1	Gravel Base Course	Ton	2,650	\$	\$
19	32 1132-4.2	Select Granular Borrow	Ton	2,900	\$	\$
20	32 1132-4.3	Geotextile Fabric	SY	3,820	\$	\$
21	32 1132-4.4	Geosynthetic Geogrid	SY	3820	\$	\$
22	32 1216-4.1	Bituminous Pavement	Ton	700	\$	\$
23	32 1216-4.1	Bituminous Pavement Patching	Ton	35	\$	\$

HARRISON ST AND MORK ST EXTENSION  
LAKE BENTON, MINNESOTA

-----

Item No.	SPEC SECTION	Description	Unit	Estimated Quantity	Bid Unit Price	Bid Amount
24	32 1216-4.2	Bituminous Sampling and Testing	Each	4	\$	\$
25	32 1613-4.1	Concrete Curb and Gutter	LF	1,710	\$	\$
26	32 1613-4.2	Concrete Fillet Section	SF	505	\$	\$
27	32 1613-4.3	Concrete Valley Gutter	SF	325	\$	\$
28	32 1613-4.4	Concrete Sampling and Testing	Each	2	\$	\$
29	32 9200-4.1	Turf Establishment	Lump Sum	1	\$	\$
30	33 1000-4.2	4" Dia. PVC Watermain Pipe	LF	12	\$	\$
31	33 1000-4.2	6" Dia. PVC Watermain Pipe	LF	800	\$	\$
32	33 1000-4.3	4" D.I. M.J. Sleeve with Joint Restraints	Each	1	\$	\$
33	33 1000-4.3	6" D.I. M.J. Plug with Joint Restraints	Each	2	\$	\$
34	33 1000-4.3	8" D.I. M.J. Foster Adapter with Joint Restraints	Each	1	\$	\$
35	33 1000-4.3	8" x 6" D.I. M.J. Reducer with Joint Restraints	Each	1	\$	\$
36	33 1000-4.3	6" x 4" D.I. M.J. Tee with Joint Restraints	Each	1	\$	\$
37	33 1000-4.3	6" x 6" D.I. M.J. Tee with Joint Restraints	Each	3	\$	\$
38	33 1000-4.3	6" D.I. M.J. Cap with Joint Restraints	Each	1	\$	\$
39	33 1000-4.4	4" D.I. M.J. Gate Valve & Box with Joint Restraints	Each	1	\$	\$
40	33 1000-4.4	6" D.I. M.J. Gate Valve & Box with Joint Restraints	Each	3	\$	\$
41	33 1000-4.5	Fire Hydrant with Joint Restraints	Each	1	\$	\$
42	33 1000-4.6	Concrete for Thrust Blocks	CY	5	\$	\$
43	33 1000-4.7	1" Dia. Water Service Line	LF	725	\$	\$
44	33 1000-4.8	1" Corporation Stop and Service Saddle	Each	14	\$	\$
45	33 1000-4.9	1" Curb Stop & Box	Each	14	\$	\$
46	33 1000-4.10	Adjustment of Valve Boxes	Each	2	\$	\$

EJCDC® C-410, Bid Form for Construction Contract.

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies,  
and American Society of Civil Engineers. All rights reserved.

Item No.	SPEC SECTION	Description	Unit	Estimated Quantity	Bid Unit Price	Bid Amount
47	33 3000-4.2	4" Dia. PVC Gravity Sewer Pipe	LF	315	\$	\$
48	33 3000-4.2	8" Dia. PVC Gravity Sewer Pipe	LF	626	\$	\$
49	32 3000-4.3	8"x 4" Sanitary Sewer Wye Service	Each	9	\$	\$
50	32 3000-4.4	48" Dia. Sanitary Sewer Drop Manhole	Each	1	\$	\$
51	33 3000-4.5	Additional Vertical Feet Manhole	VF	1.75	\$	\$
52	33 3000-4.6	Sanitary Sewer Cleanout	Each	2	\$	\$
53	33 3000-4.7	Adjustment of Manholes and Covers	Each	2	\$	\$
<b>Total of All Unit Price Bid Items</b>						\$

B. Bidder acknowledges that:

1. Each Unit Price includes an amount considered by Bidder to be adequate to cover Contractor's overhead and profit for each separately identified item, and
2. Estimated quantities are not guaranteed and are solely for the purpose of comparison of Bids, and final payment for all Unit Price Work will be based on actual quantities, determined as provided in the Contract Documents.

**ARTICLE 4—TIME OF COMPLETION**

- 4.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before the dates or within the number of calendar days indicated in the Agreement.
- 4.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

**ARTICLE 5—BIDDER'S ACKNOWLEDGEMENTS: ACCEPTANCE PERIOD, INSTRUCTIONS, AND RECEIPT OF ADDENDA**

5.01 *Bid Acceptance Period*

- A. This Bid will remain subject to acceptance for 30 days after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.

5.02 *Instructions to Bidders*

- A. Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security.

5.03 *Receipt of Addenda*

A. Bidder hereby acknowledges receipt of the following Addenda:

Addendum Number	Addendum Date

**ARTICLE 6—BIDDER’S REPRESENTATIONS AND CERTIFICATIONS**

6.01 *Bidder’s Representations*

A. In submitting this Bid, Bidder represents the following:

1. Bidder has examined and carefully studied the Bidding Documents, including Addenda.
2. Bidder has visited the Site, conducted a thorough visual examination of the Site and adjacent areas, and become familiar with the general, local, and Site conditions that may affect cost, progress, and performance of the Work.
3. Bidder is familiar with all Laws and Regulations that may affect cost, progress, and performance of the Work.
4. Bidder has carefully studied the reports of explorations and tests of subsurface conditions at or adjacent to the Site and the drawings of physical conditions relating to existing surface or subsurface structures at the Site that have been identified in the Supplementary Conditions, with respect to the Technical Data in such reports and drawings.
5. Bidder has carefully studied the reports and drawings relating to Hazardous Environmental Conditions, if any, at or adjacent to the Site that have been identified in the Supplementary Conditions, with respect to Technical Data in such reports and drawings.
6. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and the Technical Data identified in the Supplementary Conditions or by definition, with respect to the effect of such information, observations, and Technical Data on (a) the cost, progress, and performance of the Work; (b) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder, if selected as Contractor; and (c) Bidder’s (Contractor’s) safety precautions and programs.
7. Based on the information and observations referred to in the preceding paragraph, Bidder agrees that no further examinations, investigations, explorations, tests, studies, or data are necessary for the performance of the Work at the Contract Price, within the Contract Times, and in accordance with the other terms and conditions of the Contract.
8. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.

9. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and of discrepancies between Site conditions and the Contract Documents, and the written resolution thereof by Engineer is acceptable to Contractor.
10. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.
11. The submission of this Bid constitutes an incontrovertible representation by Bidder that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

6.02 *Bidder's Certifications*

A. The Bidder certifies the following:

1. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation.
2. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid.
3. Bidder has not solicited or induced any individual or entity to refrain from bidding.
4. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 8.02.A:
  - a. Corrupt practice means the offering, giving, receiving, or soliciting of anything of value likely to influence the action of a public official in the bidding process.
  - b. Fraudulent practice means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition.
  - c. Collusive practice means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels.
  - d. Coercive practice means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.



HARRISON ST AND MORK ST EXTENSION  
LAKE BENTON, MINNESOTA

BIDDER hereby submits this Bid as set forth above:

Bidder:

\_\_\_\_\_  
*(typed or printed name of organization)*

By: \_\_\_\_\_  
*(individual's signature)*

Name: \_\_\_\_\_  
*(typed or printed)*

Title: \_\_\_\_\_  
*(typed or printed)*

Date: \_\_\_\_\_  
*(typed or printed)*

*If Bidder is a corporation, a partnership, or a joint venture, attach evidence of authority to sign.*

Attest: \_\_\_\_\_  
*(individual's signature)*

Name: \_\_\_\_\_  
*(typed or printed)*

Title: \_\_\_\_\_  
*(typed or printed)*

Date: \_\_\_\_\_  
*(typed or printed)*

Address for giving notices:

\_\_\_\_\_  
\_\_\_\_\_

Bidder's Contact:

Name: \_\_\_\_\_  
*(typed or printed)*

Title: \_\_\_\_\_  
*(typed or printed)*

Phone: \_\_\_\_\_

Email: \_\_\_\_\_

Address: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Bidder's Contractor License No.: (if applicable) \_\_\_\_\_

SPEC REF. SECTION	DESCRIPTION OF WORK AND MATERIALS	UNIT	QUANTITY
01 0000-5.4	Traffic Control	Lump Sum	1
01 7113-2.1	Mobilization	Lump Sum	1
31 2300-4.2	Granular Embedment	Ton	500
31 2300-4.3	Pipe Foundation Material	Ton	30
31 2400-4.2	Remove Bituminous Surfacing	SY	110
31 2400-4.2	Remove Concrete Surfacing	SF	570
31 2400-4.2	Remove Curb and Gutter	LF	4
31 2400-4.3	Compaction - Moisture / Density Tests	Each	15
31 2400-4.4	Strip and Stockpile Topsoil	CY	2,550
31 2400-4.5	Stockpile Excess Material	CY	930
31 2400-4.6	Install Stockpiled Topsoil	CY	625
31 2500-4.1	Storm Sewer Inlet Protection Device	Each	3
31 2500-4.2	Temporary Vehicle Construction Entrance	Each	2
31 2500-4.3	Concrete Washout Area	Each	1
31 2500-4.4	Erosion Control Blanket	SY	460
31 2500-4.5	Silt Fence	LF	130
31 2500-4.6	Erosion Control Wattle	LF	20
32 1132-4.1	Gravel Base Course	Ton	2,650
32 1132-4.2	Select Granular Borrow	Ton	2,900
32 1132-4.3	Geotextile Fabric	SY	3,820
32 1132-4.4	Geosynthetic Geogrid	SY	3,820
32 1216-4.1	Bituminous Pavement	Ton	700
32 1216-4.1	Bituminous Pavement Patching	Ton	35
32 1216-4.2	Bituminous Sampling and Testing	Each	4
32 1613-4.1	Concrete Curb and Gutter	LF	1,710
32 1613-4.2	Concrete Fillet Section	SF	505
32 1613-4.3	Concrete Valley Gutter	SF	325
32 1613-4.4	Concrete Sampling and Testing	Each	2

32 9200-4.1	Turf Establishment	Lump Sum	1
33 1000-4.2	4" Dia. PVC Watermain Pipe	LF	12
33 1000-4.2	6" Dia. PVC Watermain Pipe	LF	800
33 1000-4.3	4" D.I. M.J. Sleeve with Joint Restraints	Each	1
33 1000-4.3	6" D.I. M.J. Plug with Joint Restraints	Each	2
33 1000-4.3	8" D.I. M.J. Foster Adapter with Joint Restraints	Each	1
33 1000-4.3	8" x 6" D.I. M.J. Reducer with Joint Restraints	Each	1
33 1000-4.3	6" x 4" D.I. M.J. Tee with Joint Restraints	Each	1
33 1000-4.3	6" x 6" D.I. M.J. Tee with Joint Restraints	Each	3
33 1000-4.3	6" D.I. M.J. Cap with Joint Restraints	Each	1
33 1000-4.4	4" D.I. M.J. Gate Valve & Box with Joint Restraints	Each	1
33 1000-4.4	6" D.I. M.J. Gate Valve & Box with Joint Restraints	Each	3
33 1000-4.5	Fire Hydrant with Joint Restraints	Each	1
33 1000-4.6	Concrete for Thrust Blocks	CY	5
33 1000-4.7	1" Dia. Water Service Line	LF	725
33 1000-4.8	1" Corporation Stop and Service Saddle	Each	14
33 1000-4.9	1" Curb Stop & Box	Each	14
33 1000-4.10	Adjustment of Valve Boxes	Each	2
33 3000-4.2	4" Dia. PVC Gravity Sewer Pipe	LF	315
33 3000-4.2	8" Dia. PVC Gravity Sewer Pipe	LF	626
32 3000-4.3	8"x 4" Sanitary Sewer Wye Service	Each	9
32 3000-4.4	48" Dia. Sanitary Sewer Drop Manhole	Each	1
33 3000-4.5	Additional Vertical Feet Manhole	VF	1.75
33 3000-4.6	Sanitary Sewer Cleanout	Each	2
33 3000-4.7	Adjustment of Manholes and Covers	Each	2

PROJECT / SHEET TITLE: HARRISON ST & MORK ST EXTENSION

ESTIMATE OF QUANTITIES

LAKE BENTON, MINNESOTA

DESCRIPTION

ADDENDUM 02 - REVISED QUANTITIES

REV. DATE

01 3/11/2022


I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Print Name: SCOTT D. LEDGER  
 Signature: *[Signature]*  
 Date: 3/11/22 License #: 26818

JOB No.: 23629-00  
 DATE: MARCH 2022  
 ENG / ARCH: SDL  
 DESIGNER: LJB  
 TECHNICIAN: JLU


SCALE REDUCTION BAR  
 0 1/2" 1"

SHEET No.: B-1

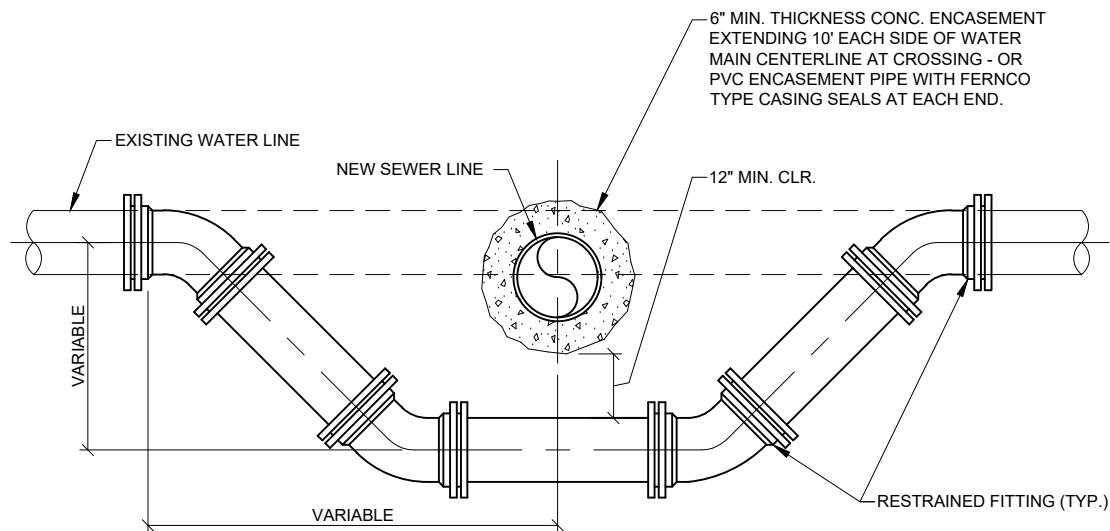


**DETAIL - ADJUSTMENT OF WATERLINE**

SCALE: NONE

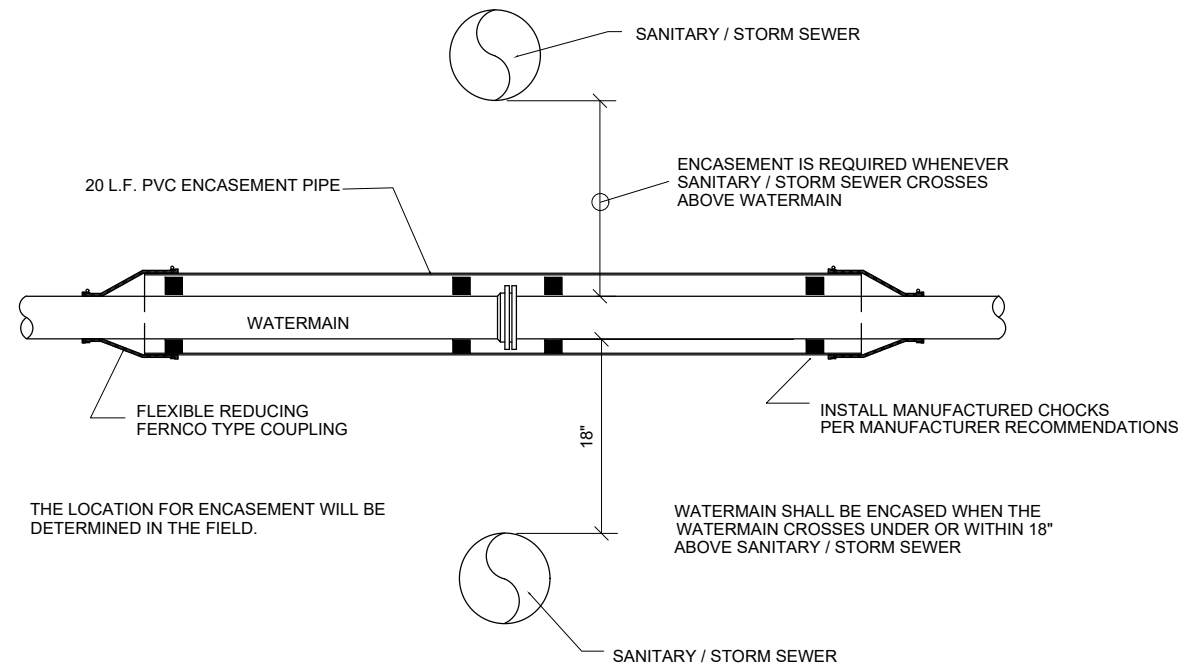

**PVC ENCASEMENT PIPE**


SCALE: NONE

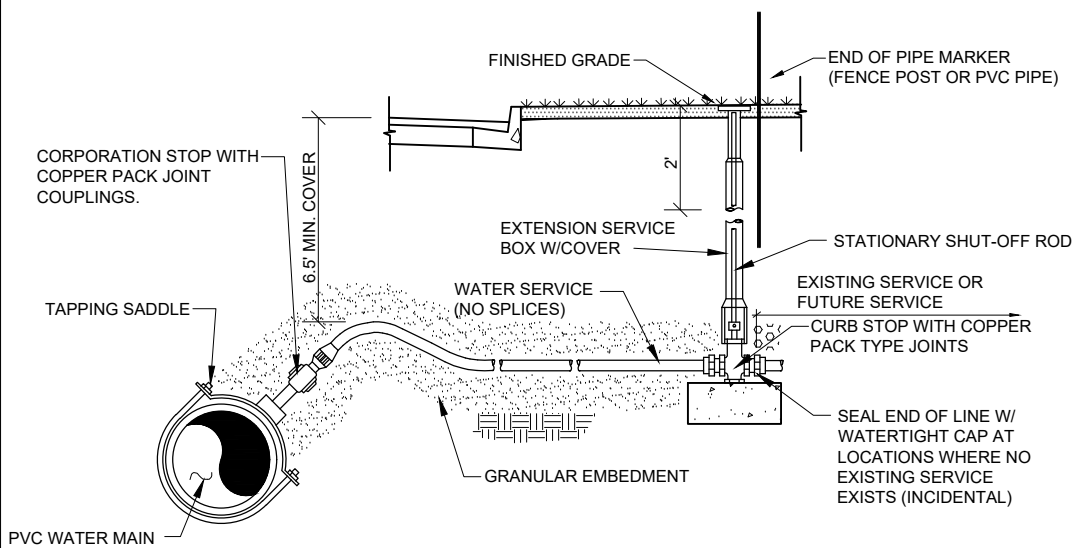

**WATER SERVICE CONNECTION DETAIL**


**1-INCH AND SMALLER**

SCALE: NONE

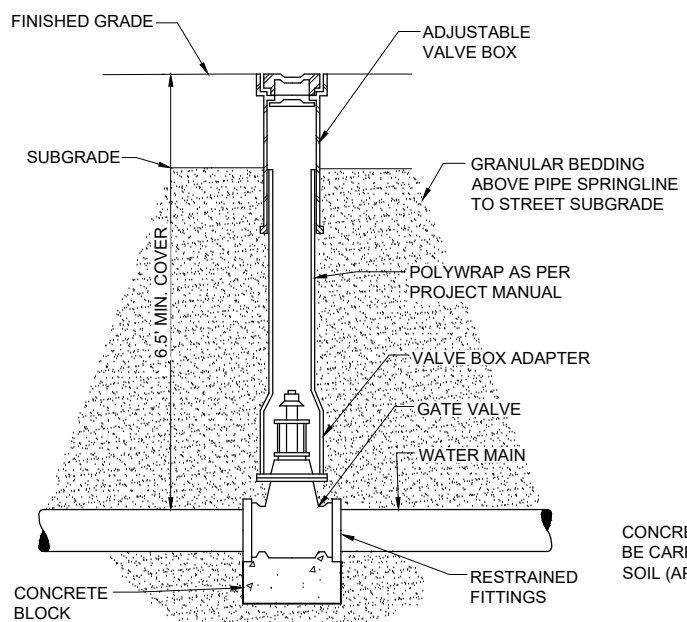

**VALVE BOX DETAIL**

SCALE: NONE

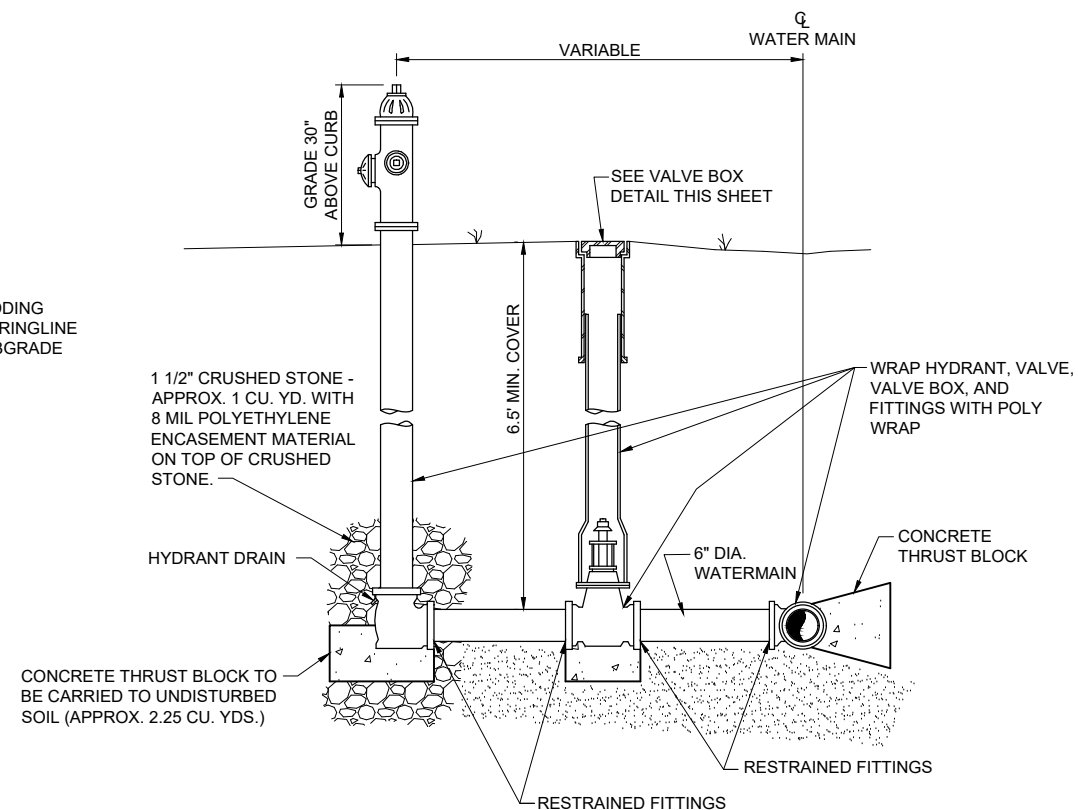

NOTE: VALVE SHALL BE SET A SUFFICIENT DISTANCE FROM THE FIRE HYDRANT TO ALLOW THE OWNER TO OPERATE THE VALVE WRENCH WITHOUT CONFLICT WITH THE HYDRANT

**FIRE HYDRANT SETTING DETAIL**

SCALE: NONE

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Print Name: SCOTT D. LEIDY  
Signature: *Scott D. Leidy*  
Date: 3/11/22 License #: 26814

JOB No.: 23629-00

DATE: MARCH 2022

ENG / ARCH: SDL

DESIGNER: LJB

TECHNICIAN: JLU

SCALE REDUCTION BAR

1" = 12"

SHEET No.:

**N-3**